



NOTE:
ELECTRICAL AND LIGHTING NOTES, DRAWINGS AND DETAILS ARE FOR INFORMATION PURPOSES ONLY. CONTRACTOR TO PROVIDE FULL DESIGN SERVICES FOR ELECTRICAL AND LIGHTING WORK AND IS RESPONSIBLE FOR ALL NECESSARY APPROVALS. THE CONTRACTOR IS RESPONSIBLE FOR ALL ELECTRICAL DESIGN, CONSTRUCTION AND SUPPLY FOR THE PROJECT. ALL ELECTRICAL WORK PROVIDED SHALL BE IN ACCORDANCE WITH THE CANADIAN ELECTRICAL CODE AND LOCAL ORDINANCES.

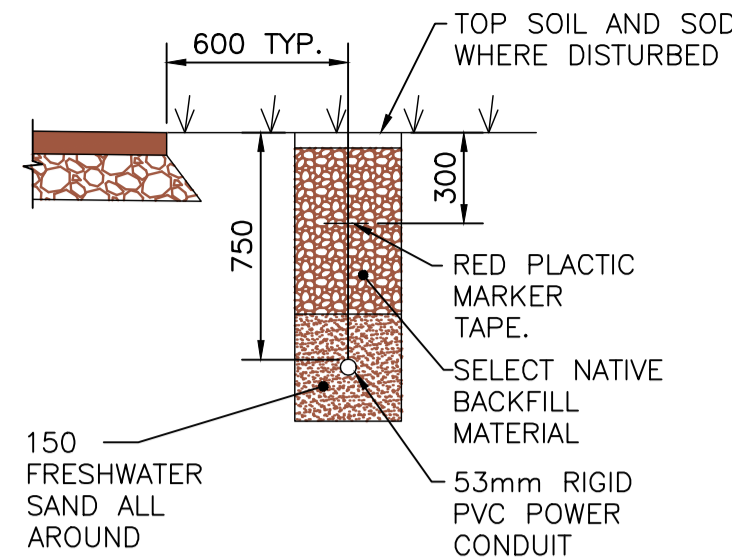


DETAIL 4
SCALE 1:25
2 UNDERGROUND ELEC. CONDUIT

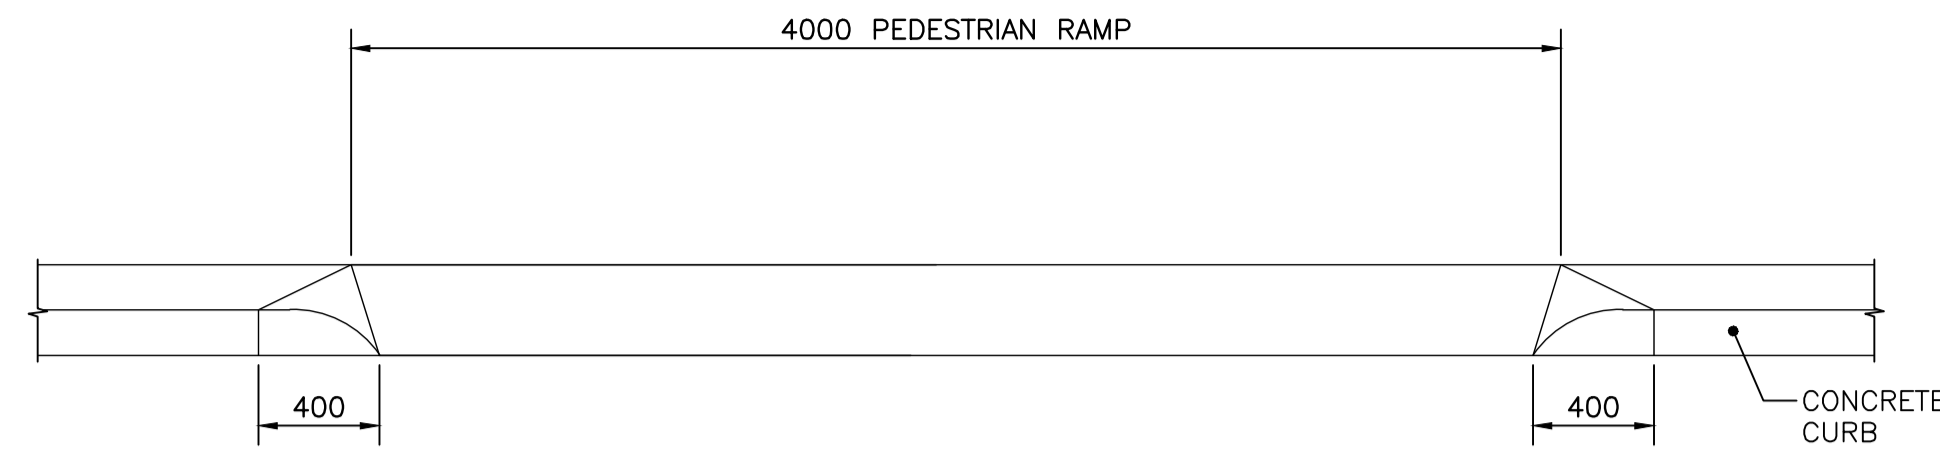


DETAIL 5
SCALE 1:25
1,3 DEPRESSED CURB

NOTE:
ALL NEW CHAIN LINK FENCE SHALL BE GALVANIZED C/W GALVANIZED HARDWARE AND COMPONENTS

CLF NOTE:
CONTRACTOR TO ENSURE THAT ALL CHAIN LINK FENCES IS INSTALLED IN ACCORDANCE WITH RETAINING WALL MANUFACTURER'S RECOMMENDATIONS.

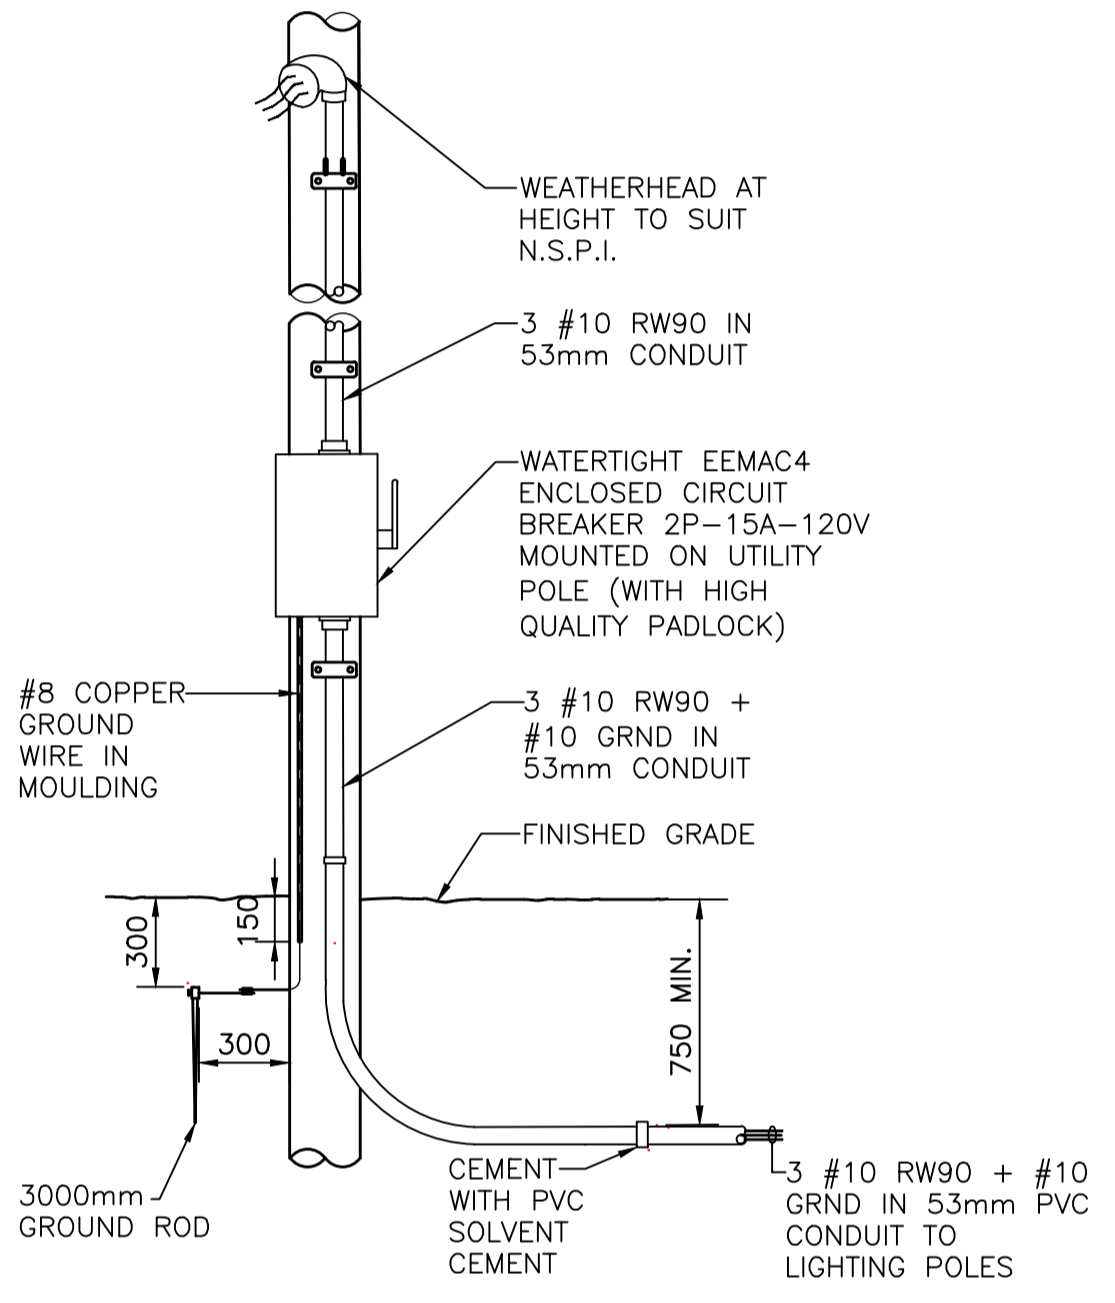


DETAIL 7
SCALE 1:25
2 ELECTRICAL CONNECTION A

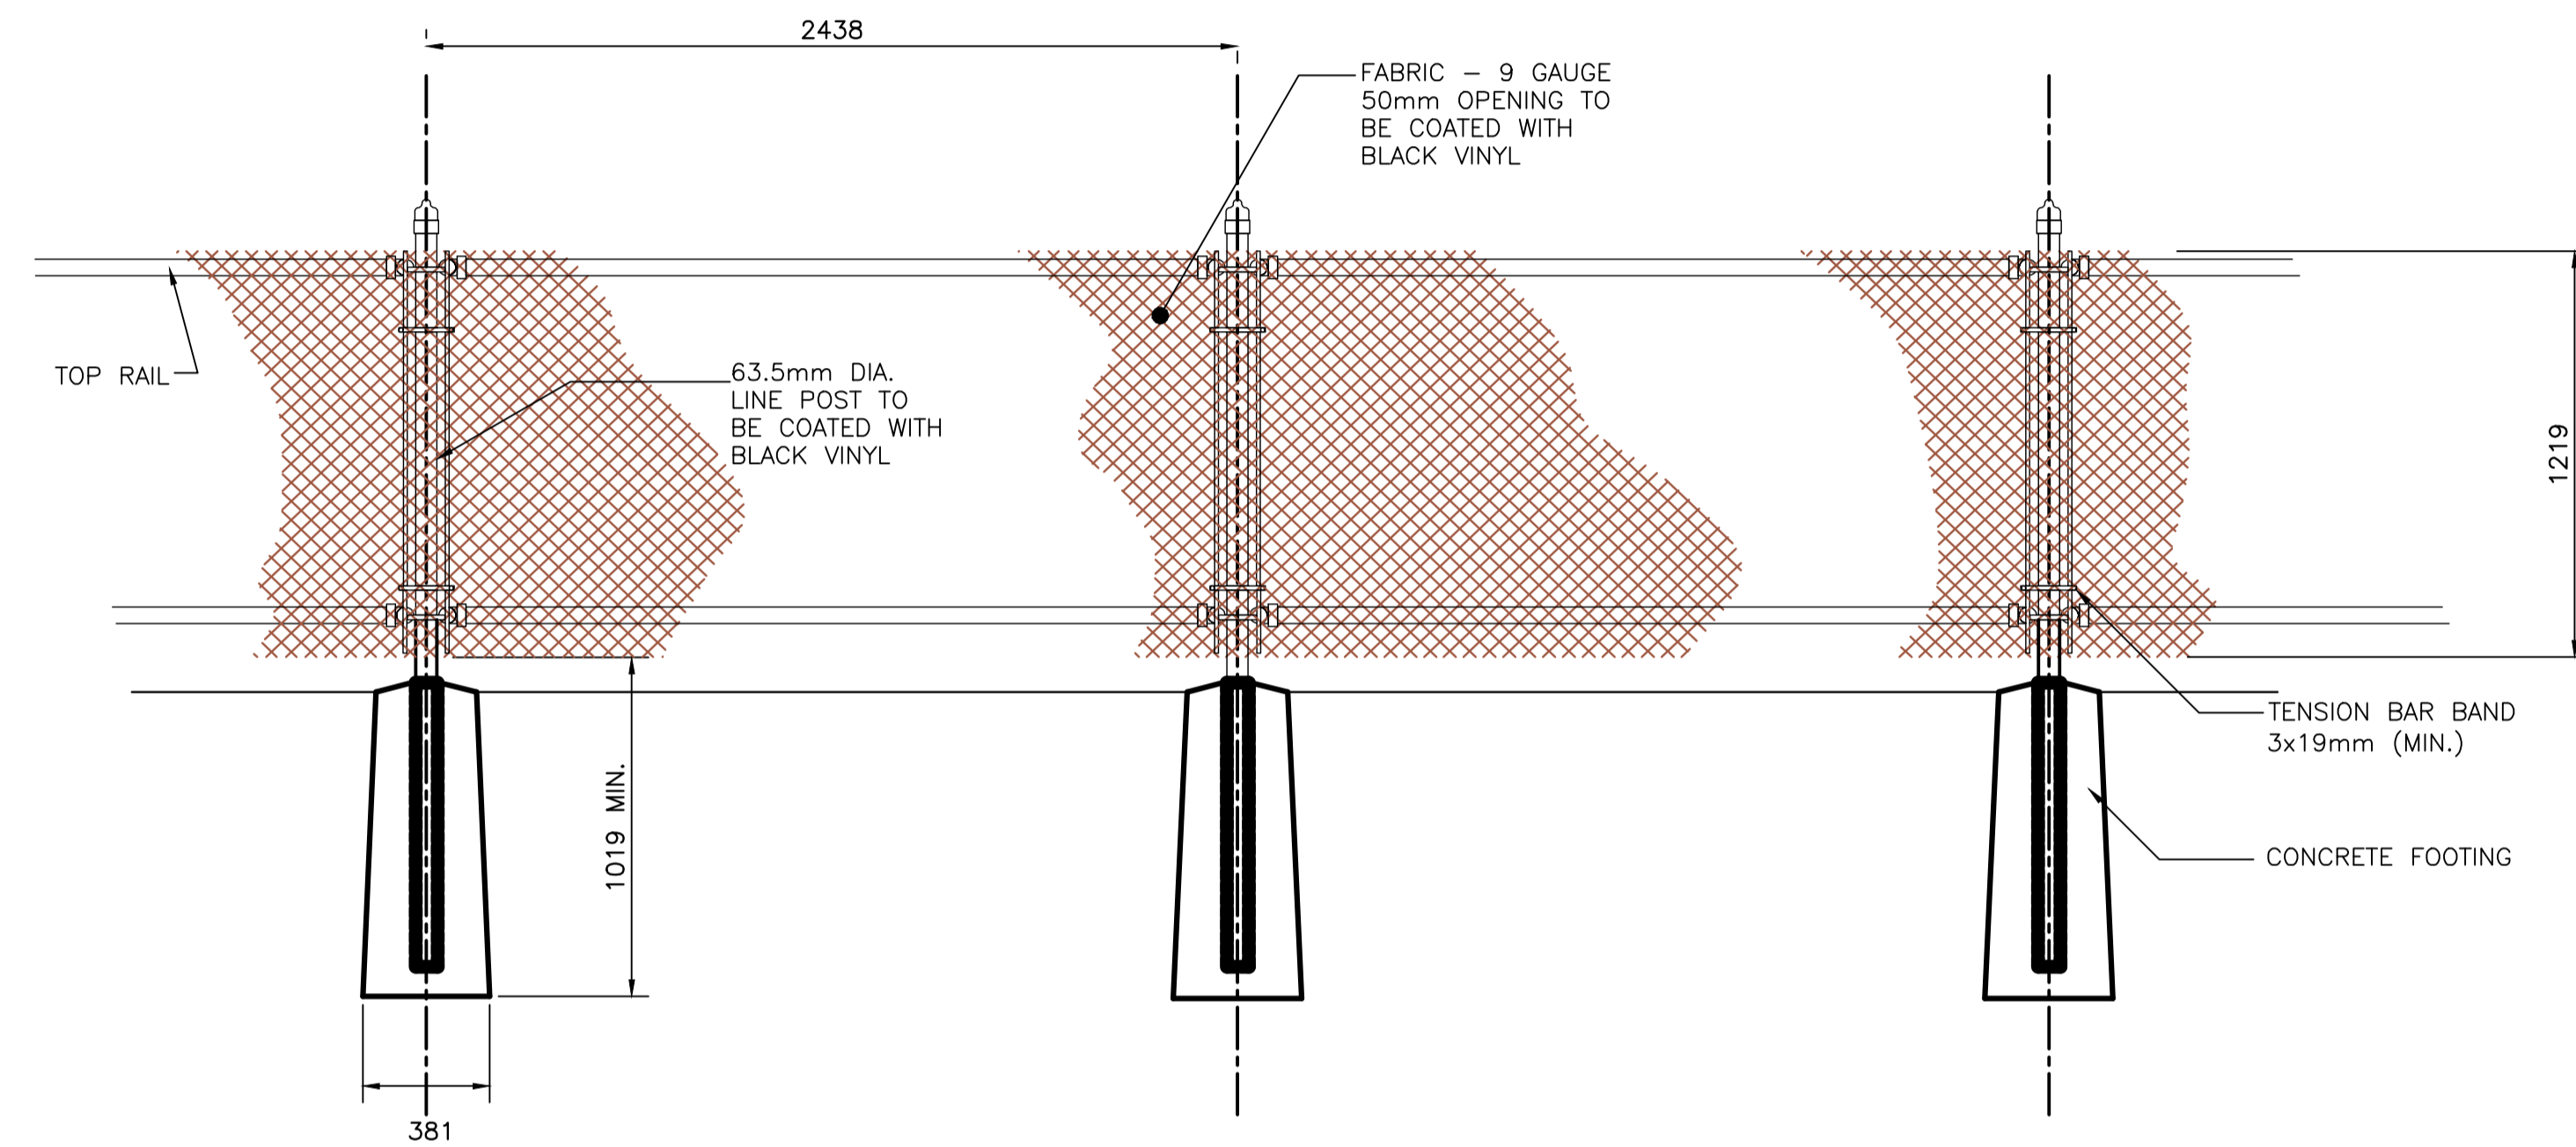

DETAIL 8
SCALE 1:20
2 RETAINING WALL FENCE

ELECTRICAL NOTES


- ELECTRICAL AND LIGHTING NOTES, DRAWINGS AND DETAILS ARE FOR INFORMATION PURPOSES ONLY. CONTRACTOR TO PROVIDE FULL DESIGN SERVICES FOR ELECTRICAL AND LIGHTING WORK AND IS RESPONSIBLE FOR ALL NECESSARY APPROVALS. THE CONTRACTOR IS RESPONSIBLE FOR ALL ELECTRICAL DESIGN, CONSTRUCTION AND SUPPLY FOR THE PROJECT. ALL ELECTRICAL WORK PROVIDED SHALL BE IN ACCORDANCE WITH THE CANADIAN ELECTRICAL CODE AND LOCAL ORDINANCES.
- NO SPLICES IN WIRING SYSTEM WILL BE PERMITTED EXCEPT IN POLE HAND HOLES OR JUNCTION BOXES.
- ALL WIRE CONNECTIONS IN UNDERGROUND JUNCTION BOXES SHALL BE BURNDY "SERVIT" TYPE "KS" CONNECTORS "SCOTCHCAST" SPLICE KITS.
- ALL WIRING SHALL BE IN UNDERGROUND CONDUIT WITH MIN. 750mm COVER.
- WIRE IDENTIFICATION NUMBER TO BE ADDED USING "BRADY" MARKERS AT EACH BREAKER AND POLE OF EACH SINGLE PHASE CIRCUIT.
- EACH EMBEDDED CONDUIT AND DUCT SHALL BE THOROUGHLY CLEANED WITH A MANDREL IMMEDIATELY AFTER THE CONCRETE HAS BEEN POURED.
- A 6 MM WHITE POLYPROPYLENE ROPE SHALL BE INSTALLED IN EACH CONDUIT TO FACILITATE SUBSEQUENT CONDUCTOR INSTALLATION.
- ALL CONDUIT AND DUCT ENDS SHALL BE TERMINATED WITH AN APPROVED PLUG UNTIL READY FOR USE.
- ALL PVC COUPLINGS AND FITTINGS SHALL BE WELDED WITH AN APPROVED SOLVENT.
- FOR ALL UNDERGROUND DUCTBANKS, THE GROUND WIRE IS TO BE RUN INSIDE THE RIGID PVC CONDUIT.
- THE CONTRACTOR SHALL CHECK EXISTING AND FUTURE UTILITIES BEFORE COMMENCING EXCAVATION WORK.
- ALL ELECTRICAL WORK TO BE AS SPECIFIED AND IN ACCORDANCE WITH THE CANADIAN ELECTRICAL CODE AND LOCAL ORDINANCES.
- STREET LIGHTING BASE TO BE AS PER HRM'S TRAFFIC SIGNAL BASE TYPE I STANDARD DETAIL. BOLT CIRCLE TO CONFORM TO SPECIFIED LIGHT STANDARD.
- PROVIDE 120 PHOTO CONTROL LOCATED IN ACCESS COVER PROVIDE UNDERGROUND FROM UTILITY POLE.
- WIRING TO BE IN 53mm RIGID PVC CONDUIT TO EACH LIGHTING STANDARD.
- ALL ELECTRICAL CONNECTIONS REQUIRED TO SERVICE LIGHT STANDARDS TO BE DETERMINED BY CONTRACTOR WITH NSPI.
- PROVIDE SERVICE TO NSP STANDARDS.

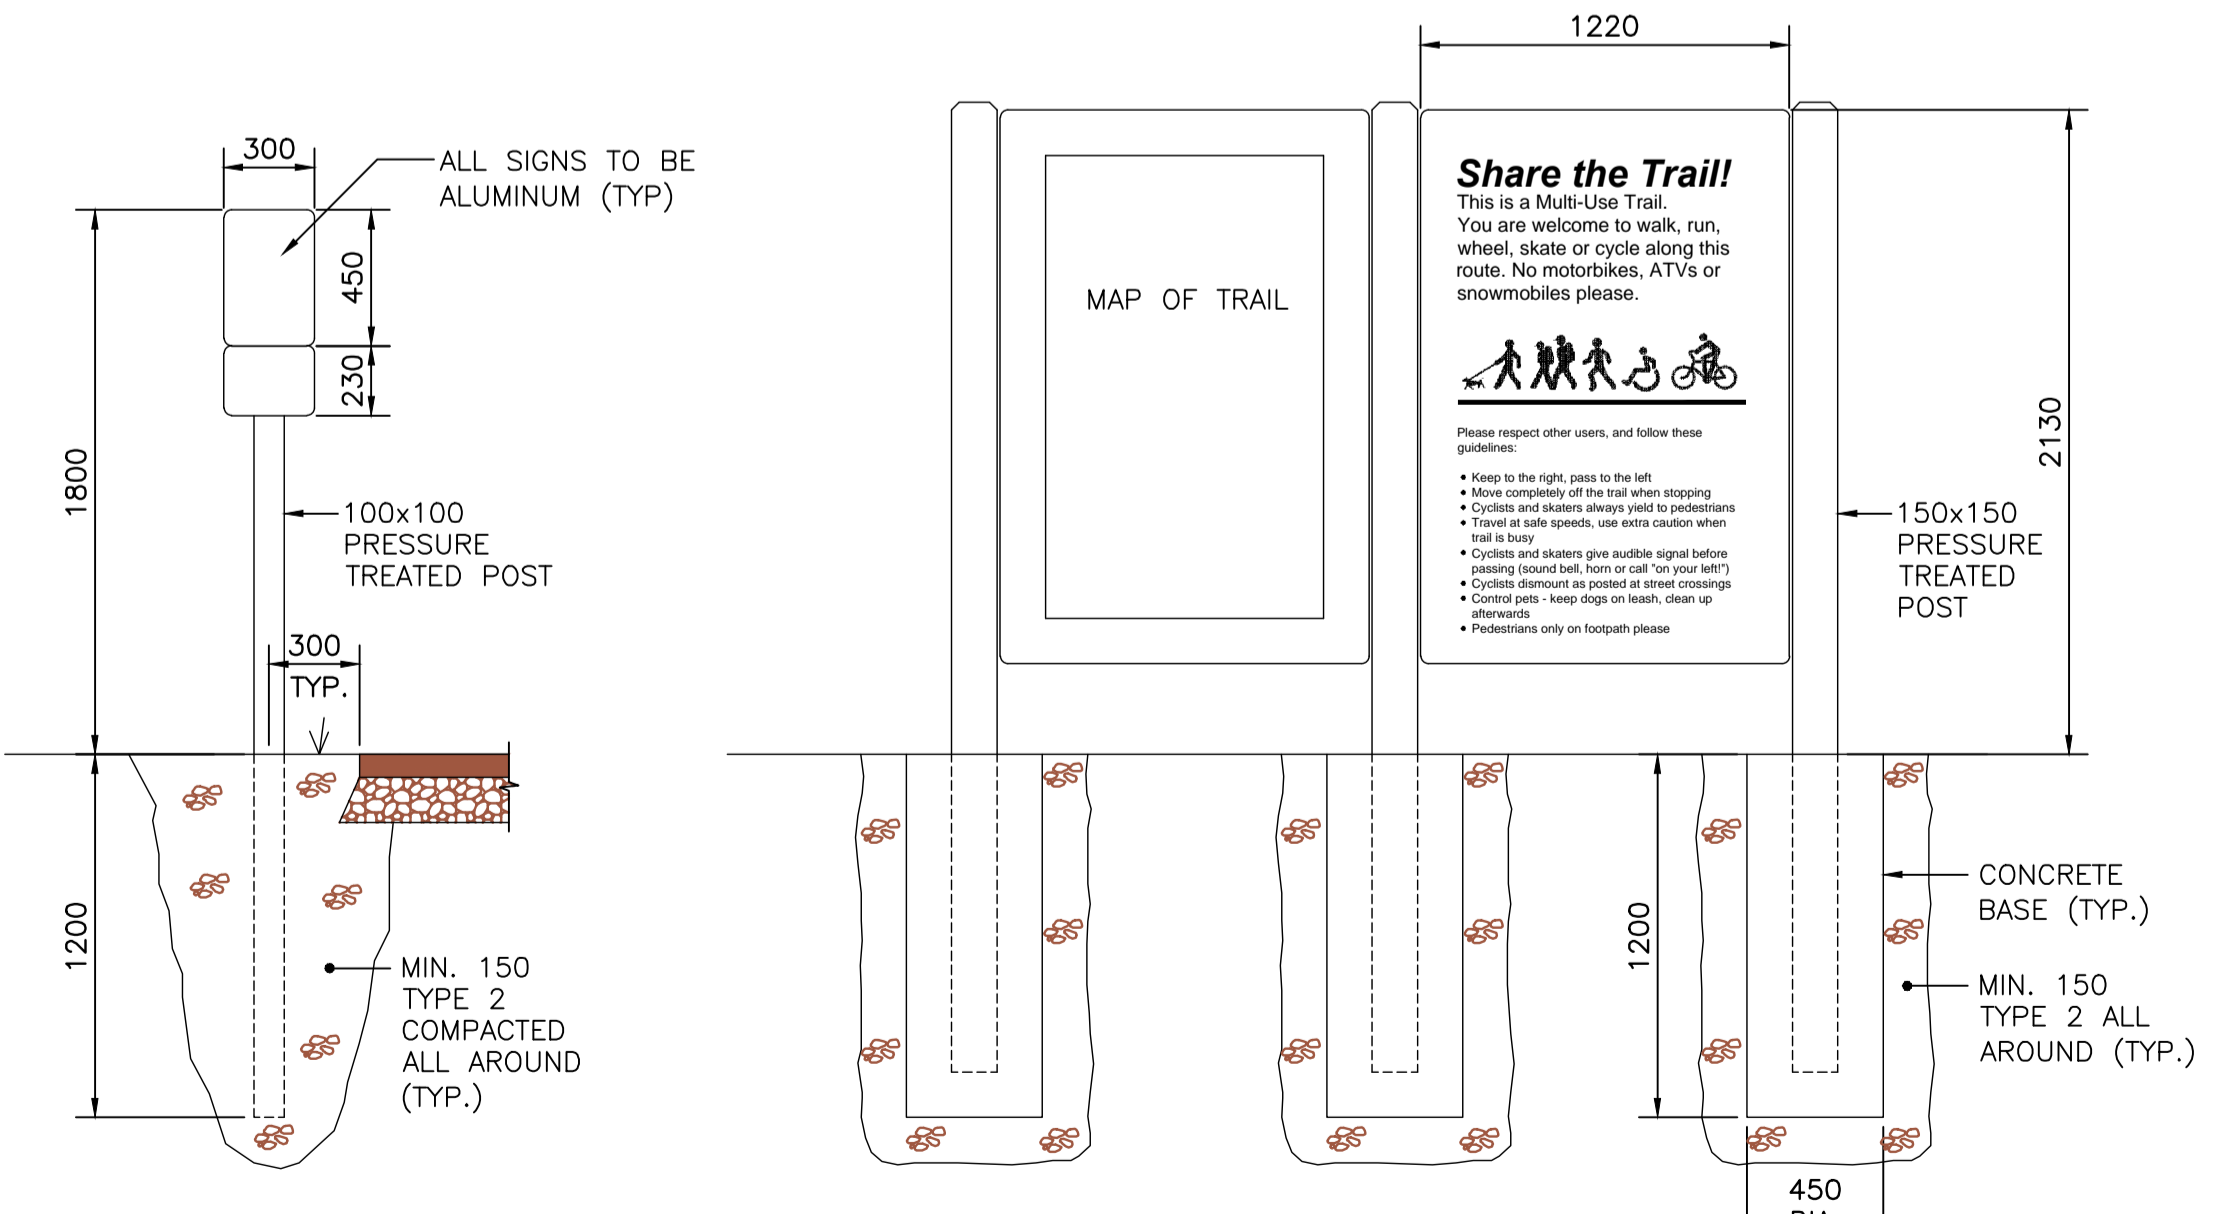


TYPICAL SIGN ELEVATION
SCALE 1:25

SIGN S1
SCALE 1:25


SIGN TABLE	
SIGN #	QUANTITY
S2A	6
S2B	1
S3	5
S4	4
S5	5
S6	2
TOTAL	23

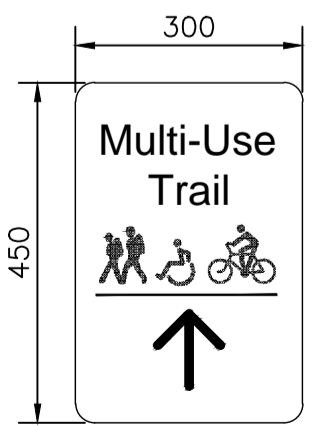


SIGN S2A
SCALE 1:10

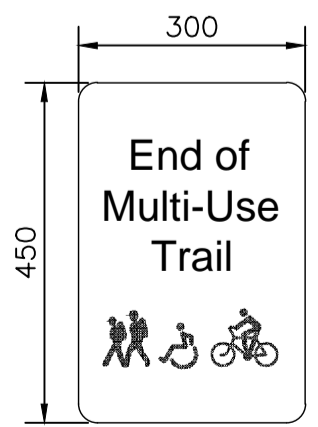


SIGN S2B
SCALE 1:10

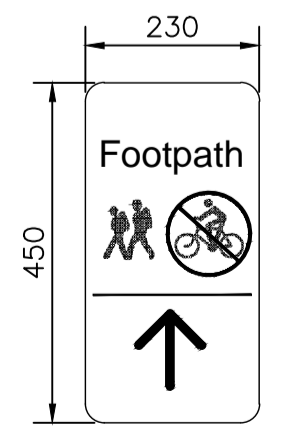


SIGN S3
SCALE 1:10

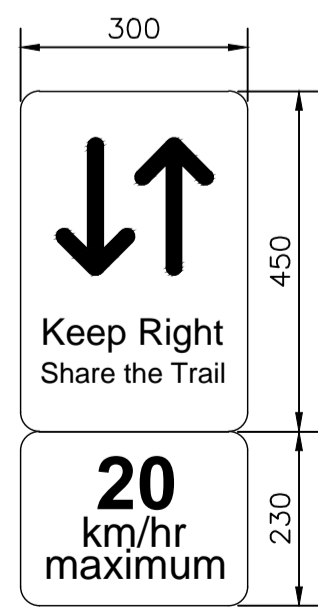

SIGN S4
SCALE 1:10

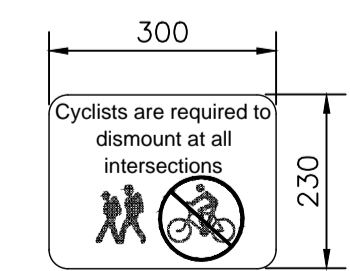

SIGN S5
SCALE 1:10

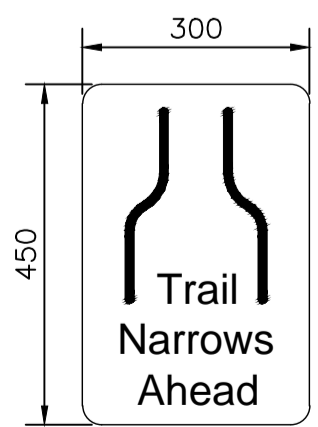

SIGN S6
SCALE 1:10



O'HALLORAN CAMPBELL
consultants limited
7071 Bayers Road
Suite 252
Halifax, Nova Scotia
B3L 2C2
Phone: (902)429-9926
Fax: (902)429-6457



HALIFAX URBAN GREENWAY

DETAILS AND SIGNAGE

Date	APR. 27, 2005	Drawn	KLW	Project No.	09-169
Scale	1:500	Checked	ALB/MWM	Sheet	
Reference	Mgr. Design Services			Plan No.	1431-4
Surveyed	Dir. Eng. Services				